


SECTION A-A'

SECTION B-B'

NOTES:

- 1. Equipment layout is representative only.
- 2. Horn Strobes shall be installed in accordance with NFPA & UFC standards as applicable.

- ☒ Supply
- ☒ Return
- ☐ Fan Coil Unit 1
- ☐ Thermostat
- ☐ Automatic Sprinklers
- ☐ Manual Pull Station

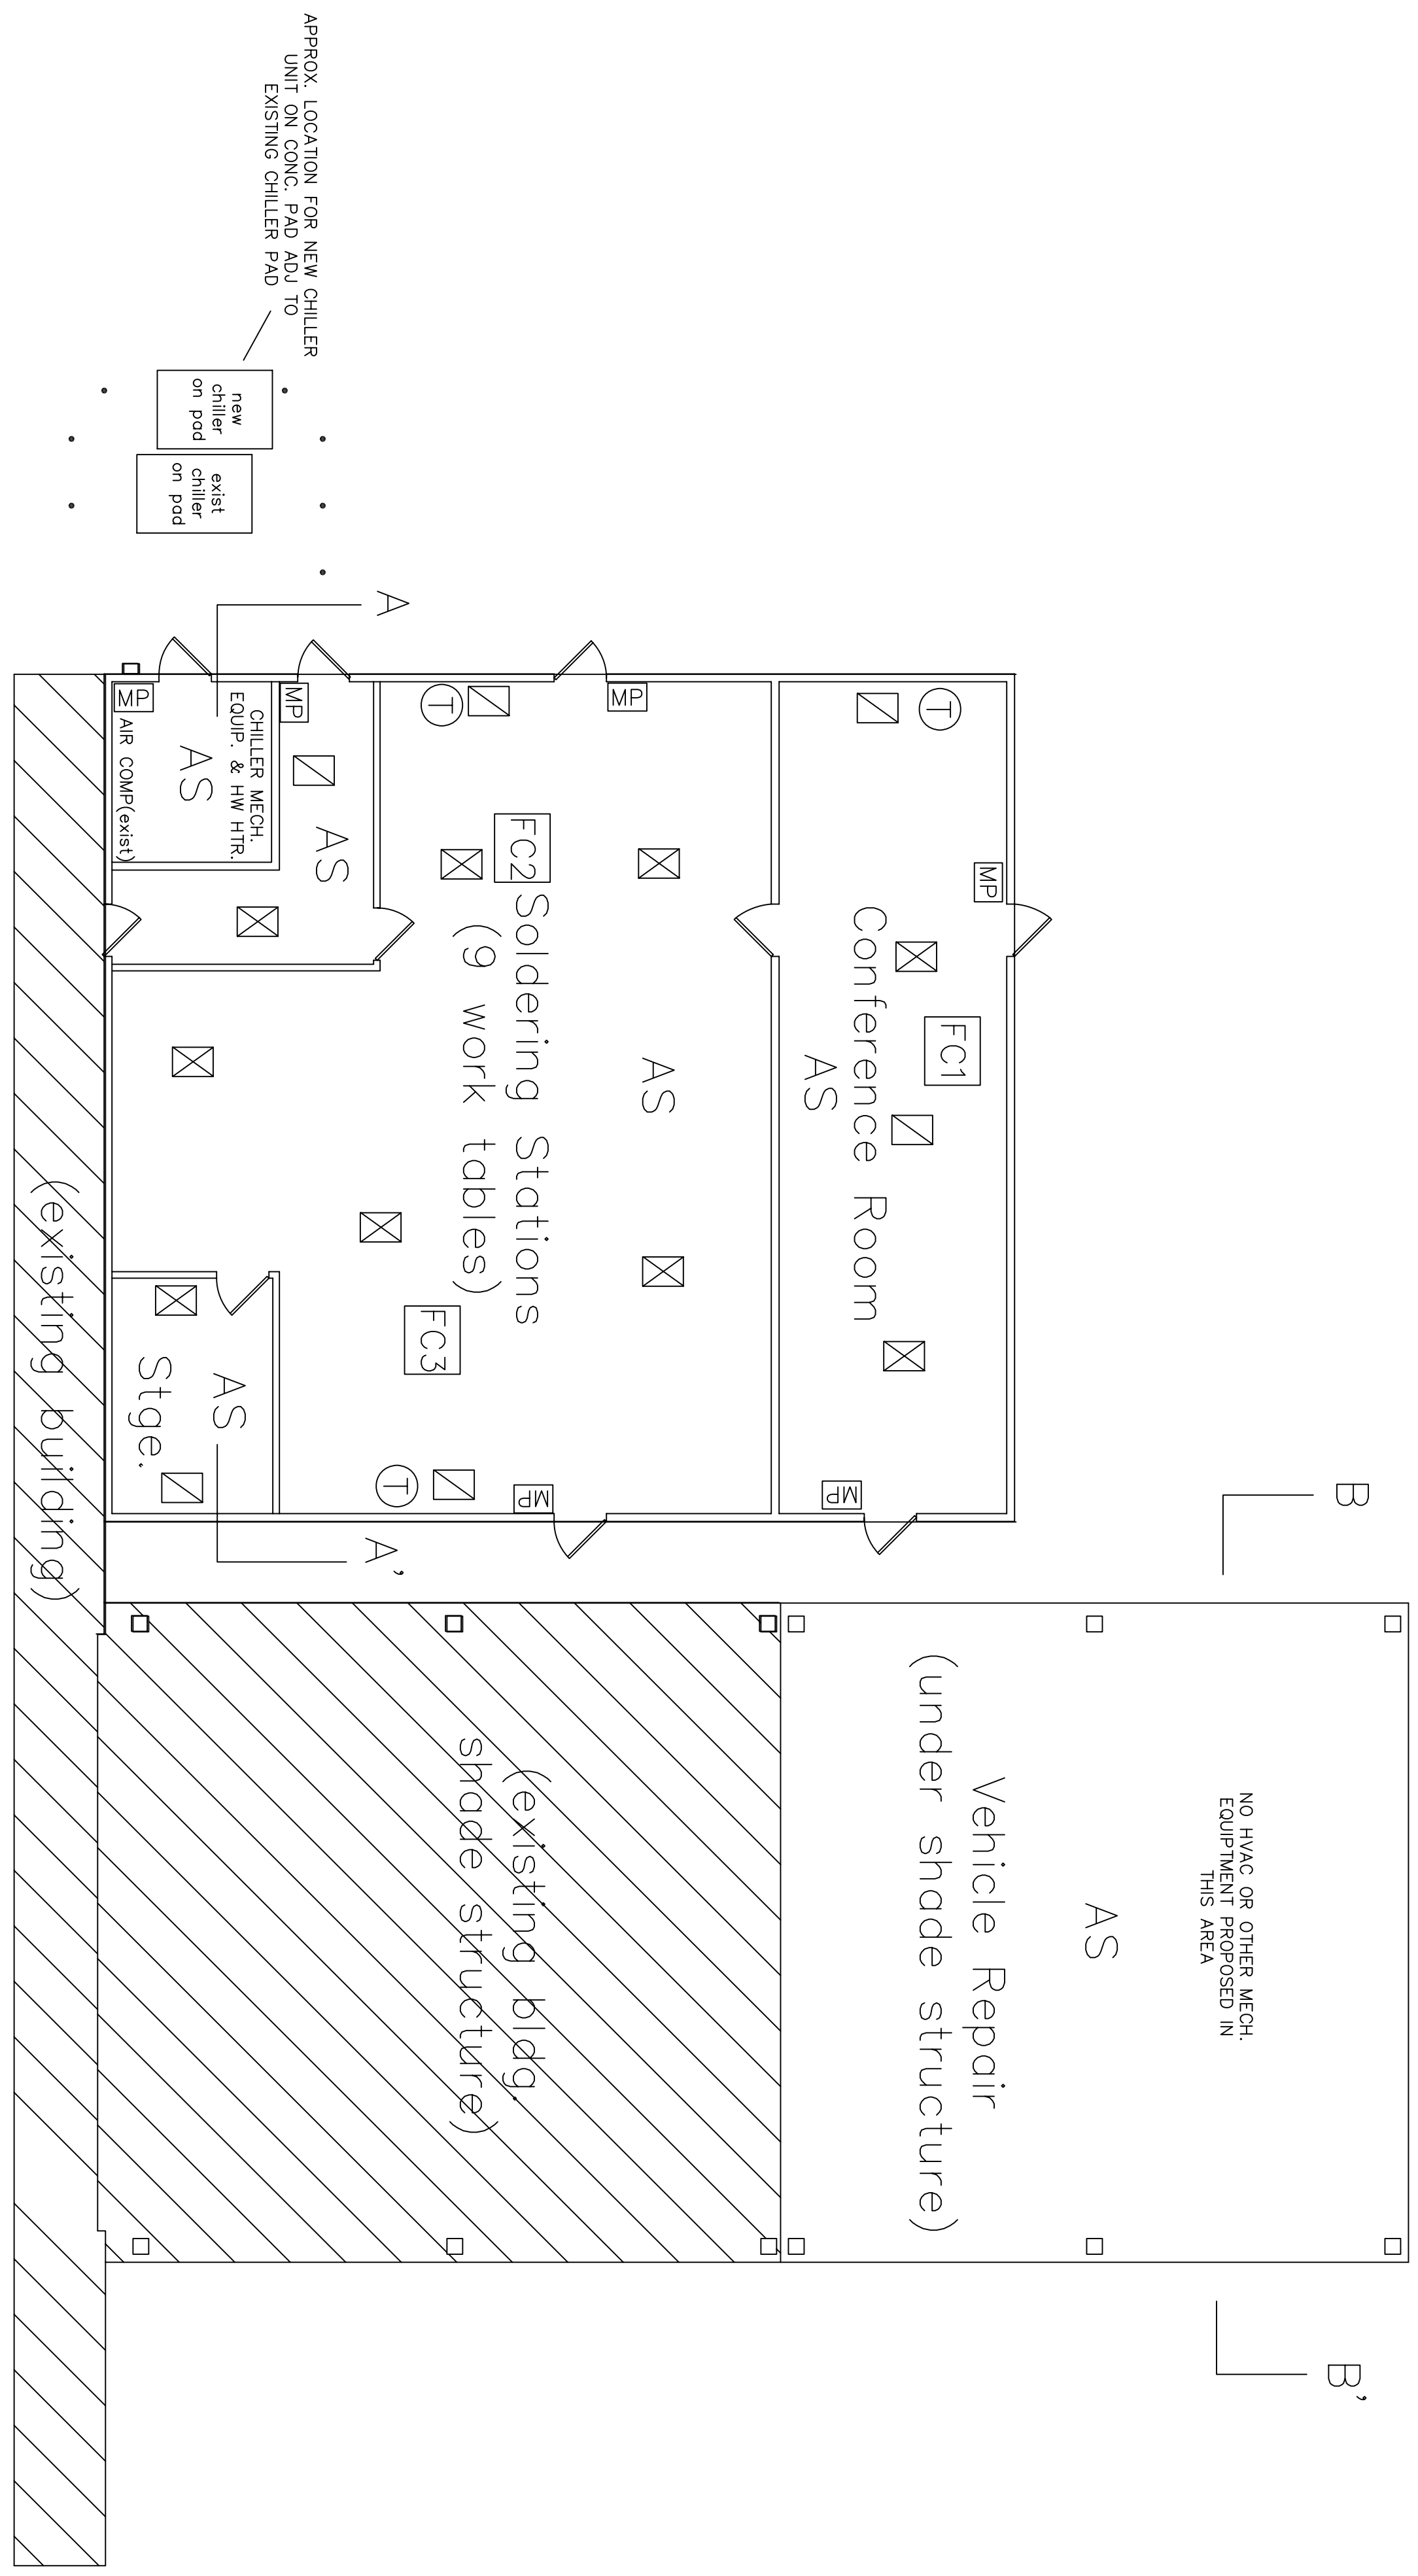

Scale: 1/8"=1'-0"